


INSTALLATION INSTRUCTIONS

MODELS TS-6, TS-7, TS-8, TS-9



U.L. FILE SA32686

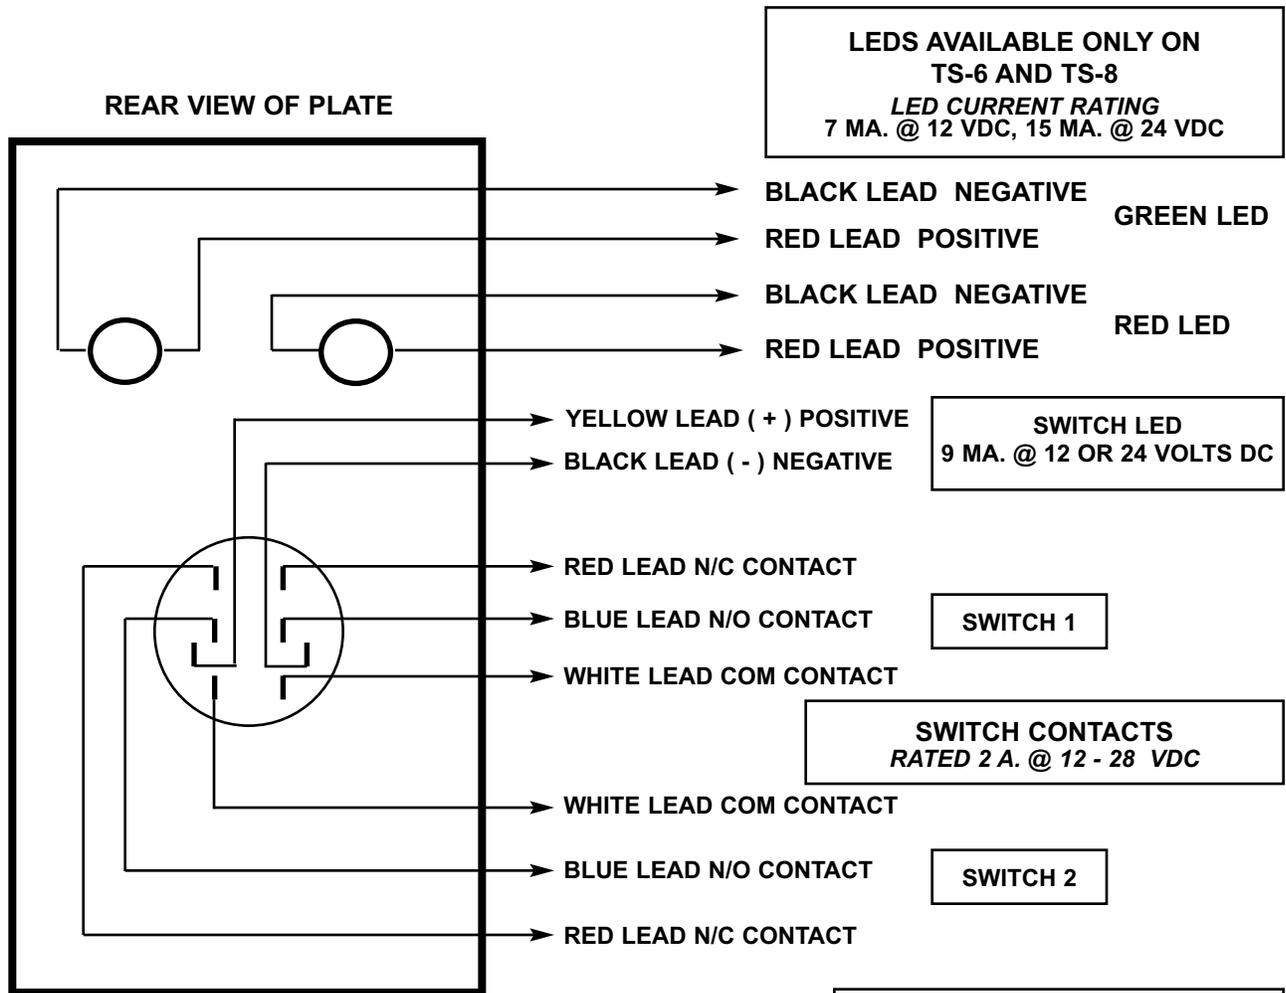

**MOUNT WALLPLATE
IN A VERTICAL POSITION**

MODELS TS-6, TS-7, TS-8 & TS-9
SHOULD BE MOUNTED IN A
2.5 INCH DEEP ELECTRICAL BOX

**FOR 24 VOLT SWITCH LED
OPERATION**

ADD 1000 OHM 1/2 WATT RESISTOR
IN SERIES WITH YELLOW LEAD.
INSULATE RESISTOR TO PREVENT
SHORTING.



ALARM CONTROLS CORPORATION
19 BRANDYWINE DRIVE P.O. BOX 280
DEER PARK, NY 11729

PH: 1 800 645-5538 1 631 586-4220 FAX ; 1 631 586-6500
WWW.ALARMCONTROLS.COM EMAIL: INFO@ALARMCONTROLS.COM